



ISSN: 0975-833X

RESEARCH ARTICLE

TRANSIENT STABILITY ENHANCEMENT OF REAL TIME SYSTEM USING ETAP

^{*1}Er. Sujatha, S., ²Dr. Anitha, R., ³Dr. Selvan, P. and ⁴Er. Selvakumar, S.

¹Assistant Engineer, TNEB, Karur, Tamilnadu, India

²Department of EEE, Institute Road and Transport Technology, Erode, Tamilnadu, India

³Department of EEE, Erode Sengunthar Engineering College, Erode, Tamilnadu, India

⁴Design Engineer, ABB Global Industries, Chennai, Tamilnadu, India

ARTICLE INFO

Article History:

Received 07th January, 2013

Received in revised form

07th February, 2014

Accepted 15th March, 2014

Published online 23rd April, 2014

Key words:

Exciter, Faults, FACTS, SVC,
Real time system, Transient stability.

ABSTRACT

The modeling of the real time system with Static VAR Compensator (SVC) using ETAP software is presented in this paper. The system is analyzed under severe disturbance to study the transient behavior by simulating three phase to ground fault at particular bus. To enhance the transient stability of the system, SVC is inserted and tested to show the effect of the same on the transient stability under severe disturbance. The potential application of SVC on the improvement of voltage profile of the various buses and reduction in rotor angle oscillation of the generator is evaluated from the implementation results.

Copyright © 2014 Er. Sujatha et al. This is an open access article distributed under the Creative Commons Attribution License, which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited.

INTRODUCTION

Transient stability evaluation focuses on the reactive power flow of the power system in response to a fault. In transient stability prediction, the progress of the power system transient due to occurrence of disturbance is to be monitored. The key factor in transient stability prediction is based on the convergence and divergence of transient swings. The problem is formulated as the insertion of SVC in real time system that is to be analyzed using ETAP simulation software for enhancing the transient stability. SVCs, with an auxiliary injection of a suitable signal, can significantly improve the dynamic stability performance of a power system (Byerly *et al.*, 1982; Hammad 1986) presented a fundamental analysis of the application of SVC for enhancing the power system stability. Also, the enhancement of low frequency oscillation damping via SVC has been analyzed (Padiyar and Varma 1991; Zhou 1993; De Oliveira 1994; Messina *et al.*, 1999). The SVC enhances the system damping of local as well as inter-area oscillation modes. Ref (Messina and Barocio 2003) studied the nonlinear model interaction in stressed power systems with multiple SVC voltage support. It is observed that SVC controller can significantly influence nonlinear system behavior especially under high-stress operating conditions and increased SVC gains (8). The general representation of SVC is represented in the Fig.1.1

MODELING OF SVC

SVCs, with an auxiliary injection of a suitable signal, can significantly improve the dynamic stability performance of a power system (Byerly *et al.*, 1982; Hammad 1986) presented a fundamental analysis of the application of SVC for enhancing the power system stability. Also, the improvement of low frequency oscillation damping via SVC has been analyzed (Padiyar and Varma 1991). The SVC improve the system damping of local as well as inter-area oscillation modes. SVC model shown in Figure 2.1, used to improve the transient stability of the real time system considered, has been modeled in ETAP 12.5

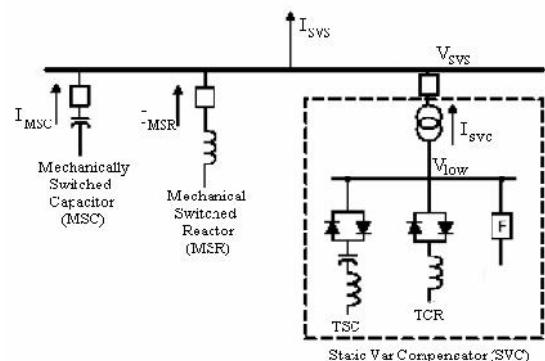


Figure 1.1. SVC employing TSC and TCR

***Corresponding author: Er. Sujatha, S.**

Assistant Engineer, TNEB, Karur, Tamilnadu, India.

This real time system is modeled using ETAP simulation software and the corresponding single line diagram is shown in Figure 3.3.

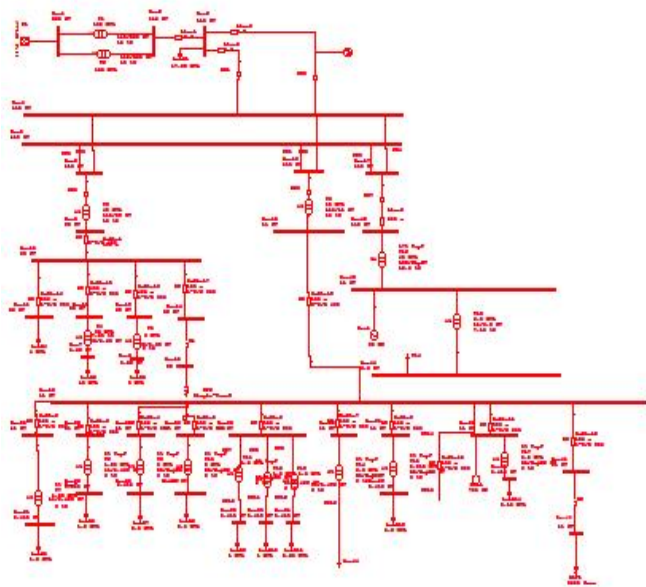


Figure 3.3. Single line diagram of real time system

Table 3.4. Turbine Governor Data For 35 Mw Generator

Variable	Description	Data
σ	Droop	0.05
Pmax	Maximum power limit	1.0
Pmin	Minimum power limit	0.1
Cmax	Rate of valve opening	0.1
Cmin	Rate of valve closing	-1.0
T1	Phase compensation 1	0.1
T2	Phase compensation 2	0.3
T3	Servo time constant	0.4
Thp	HP section time constant	0.26

SIMULATION RESULTS

The ETAP software is used to simulate the real time system yield validated results. To simulate the real time system, models have been developed for each element and implemented in the dedicated power system simulation tool ETAP which provides the ability to simulate load flow study, short circuit study and Transient events in the same software environment. The ETAP simulation tool therefore has a dedicated model for generators which take into account the current displacement in the rotor, slip and short circuit analysis curves. Also models of synchronous machines, transformers, bus bars, grid models, Transmission lines etc are provided.

TRANSIENT ANALYSIS

a. With out disturbances

The real time system was kept as ideal and the simulation results are presented here. The power generated by the generator remains constant even if the loads of the system can vary is represented in the 4.1

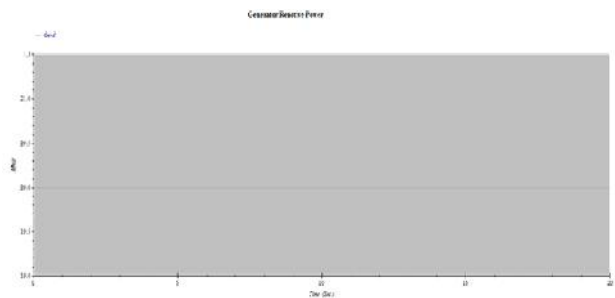


Figure 4.1 Real power P of the Generator

The given loads, the generator has to generate 20 MVar to maintain its terminal voltage is depicted in the Figure 4.2.

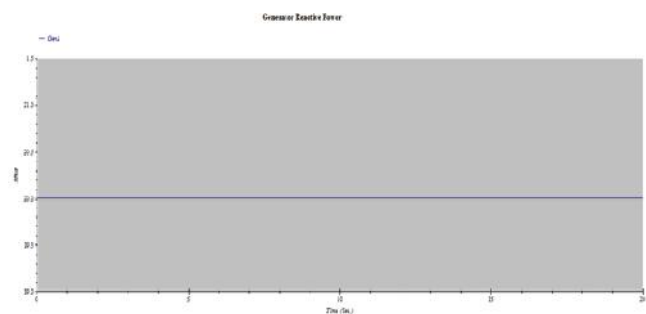


Figure 4.2 Reactive power Q of the Generator

The generator has the capability to adjust the reactive power and to maintain the voltage is represented in the Figure 4.3

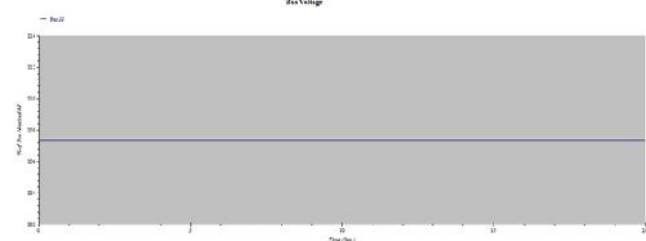


Figure 4.3 Generator bus (22) voltage

Since the 110 k V bus is considered as slack bus for the load flow study, the voltage and angle of the bus remains constant is represented in the Figure 4.4.

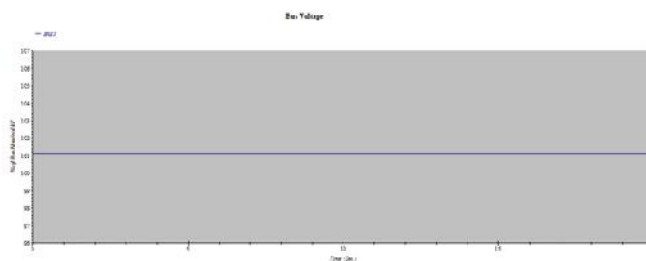


Figure 4.4 110 kV Bus (5) voltage

The 33 k V bus receives power from 110 kV grid through two winding transformer. Due to the leakage reactance of the transformer the voltage at the 33 kV bus starts falling is depicted in the Fig.4.5.

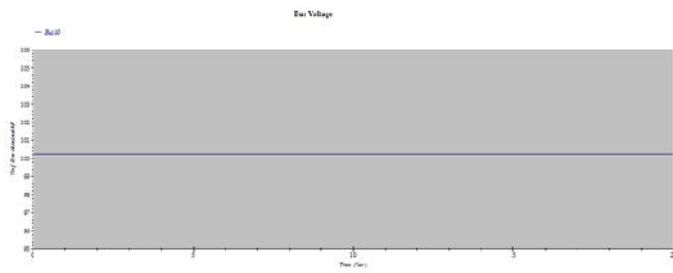


Figure 4.5. 33 kV Bus(10) voltage

11 kV bus receives the power from 110 k V grid through two winding transformer. In that real time system the generator auxiliary, EAF auxiliary, Oxygen plant loads are fed by the given transformer. The terminal voltage is 106.44 % is depicted in the Figure 4.6.

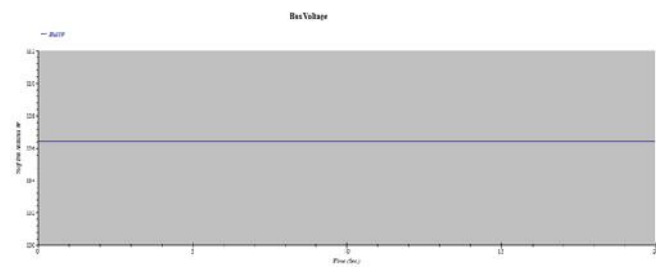


Figure 4.6. 11 kV Bus(29) voltage

b. With disturbances

Here the real time system was tested by creating the three phase to ground fault at the 11 kV bus(29) and the simulation results were produced. Figure 4.7 describes the generator will oscillate whenever there is a fault in network. The oscillation of generators is basically measured with respect to infinite bus(grid) which is represented as slack bus. The oscillation level of the generator depends on the disturbances severity and its time duration. A 100 ms duration of the three phase fault at 11 kV bus leads the generator to oscillate from 2.4 to 6 degree, whereas at the steady state condition it is 2.3 degrees with respect to grid.

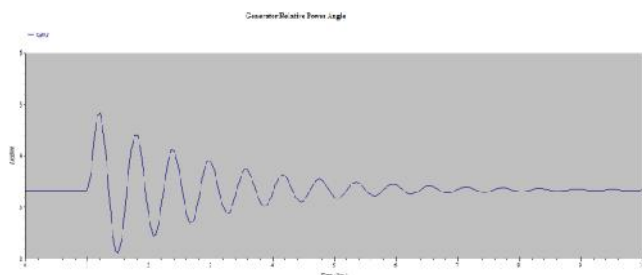


Figure 4.7. Swing curve of the generator at fault condition

Figure 4.8 describes the real power generation and reactive power generation of the generator when there is a fault at 11 kV bus. It indicates the oscillation of real power of the generator that varies from 27 MW to 43 MW.

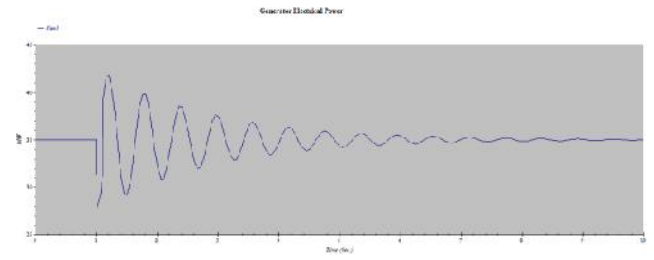


Figure 4.8 Real power P of the Generator

The reactive power of the generator drastically increases from 22 MVar to 76 MVar during the fault without any time delay because the exciter characteristics are fast in nature is represented in the Figure 4.9.

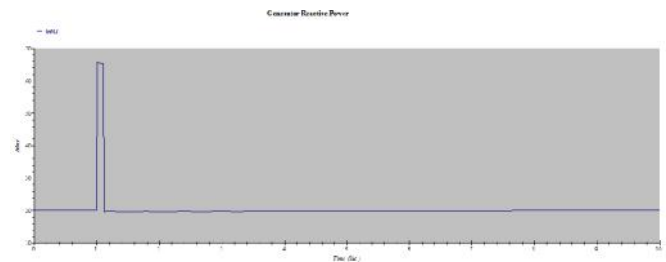


Figure 4.9 Reactive power Q of the Generator

The severity of the dip in the voltage at any bus is directly related to the distance from the fault location. Since, 110 k V grid bus is far away from the fault location, hence the voltage reduced from 100 % during fault and recovers back to normal after the clearance of the fault is described in the Figure 4.10

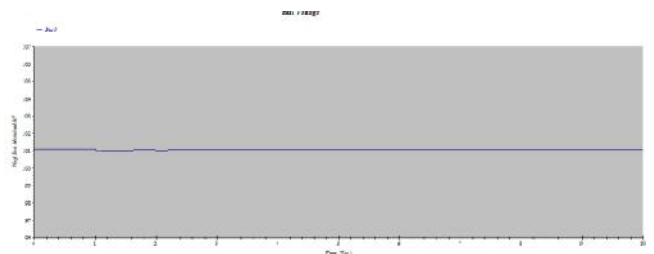


Figure 4.10. 110 kV Bus (5) voltage

The 33 kV bus is far away from the faulty 11 kV bus and two winding transformer impedances exist between the two buses, the voltage reduction is severe during fault and recovers back to normal after clearance of the fault is represented in the Figure 4.11

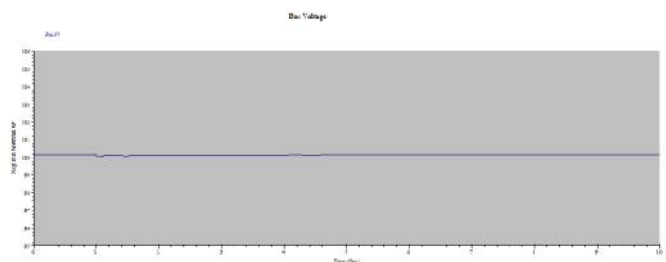


Figure 4.11. 33 kV Bus (10) voltage

Since the fault is at this bus, the voltage is zero during fault and recovers back to the normal after clearance of the fault is represented in the Figure 4.12

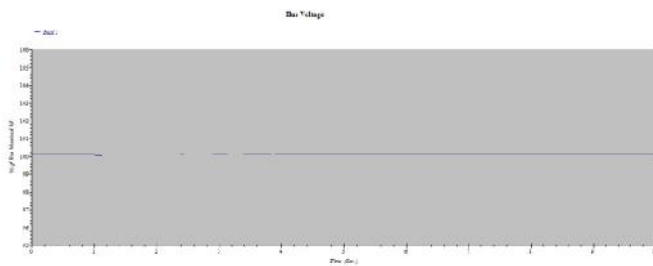


Figure 4.12 11 kV Bus (29) voltage

c. WITH SVC

The SVC is placed at 33 kV bus and fault is created at the 11 kV bus and the simulation results were produced here. SVC at 33 kV bus slightly improves the transient stability by reducing the oscillation represents the figure 4.13. The ability of the SVC at 33 kV bus significantly contributes the reactive power and improve the voltage profile of the 110 kV, 33 kV, and 11 kV bus respectively, which prevents the large motors connected to these buses to stall were represented the figure.

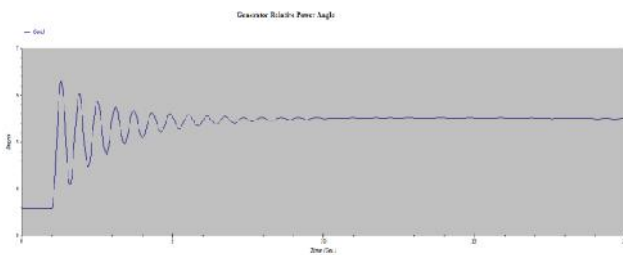


Figure 4.13 Swing curve of the generator

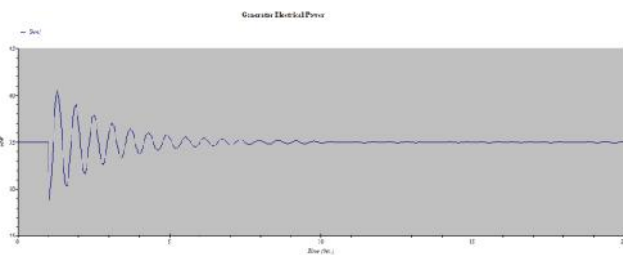


Figure 4.14 Real power P of the Generator

Conclusion

The fluctuating /non-linear nature of the load present in the real time system, SVC is considered to maintain the voltage profile and to enhance the transient stability of the system. Various cases are simulated and the response of the system are presented. Modeling of real time system with SVC is presented. SVC is modeled using ETAP for enhancing the transient stability of the system. From the transient stability analysis, SVC at 33 kV Bus improves the voltage profile of the real time system for the three phase to ground fault. However the impact of SVC on damping the rotor angle oscillation of the generator is not so effective for the system considered.

REFERENCES

- Abido, M A, 2009. "Power system stability enhancement using FACTS Controllers: A review", *The Arabian Journal for Science and Engineering*, Vol. 34, No. 2B, pp. 153-172.
- Byerly, R. T. D., Poznaniak, T. and Taylor, E. R. 1982. "Static Reactive Compensation for Power Transmission System", *IEEE Transaction. PAS-101*, pp. 3998-4005.
- Byerly, R. T. D., Poznaniak, T. and Taylor, E. R. 1982. "Static Reactive Compensation for Power Transmission System", *IEEE Transaction. PAS-101*, pp. 3998-4005.
- Chang, C. S. and Qizhi, Y. 1999. "Fuzzy Bang-Bang Control of Static VAR Compensators for Damping System-Wide Low-Frequency Oscillations", *Electric Power Systems Research*, Vol. 49, pp. 45-54.
- Chang, J. and Chow, J. 1997. "Time Optimal Series Capacitor Control for Damping Interarea Modes in Interconnected Power Systems", *IEEE Trans. PWRs*, Vol. 12, No. 1, pp. 215-221.
- Chen, X., Pahalawaththa, N., Annakkage, U. and Kumble, C. 1995. "Controlled Series Compensation for Improving the Stability of Multimachine Power Systems", *IEE Proc., Part-C*, Vol. 142, pp. 361-366.
- Chintu Rza Makkar and Lillie Dewan, 2010. "Transient Stability Enhancement using Robust FACTS controllers – A Brief Tour", *Canadian Journal on Electrical & Electronics Engineering* Vol. 1, No. 7, pp. 150-155.
- Dai, X., Liu, J., Tang, Y., Li, N. and Chen, H. 1998. "Neural Network α -th-Order Inverse Control of Thyristor Controlled Series Compensator", *Electric Power Systems Research*, Vol. 45, pp. 19-27.
- Dash, P. K. Sharaf, A. M. and Hill, E. F. 1989. "An Adaptive Stabilizer for Thyristor Controlled Static VAR Compensators for Power Systems", *IEEE Trans. PWRs*, Vol. 4, No. 2, pp. 403-410.
- Dash, P. K., Mishra, S. and Liew, A. C. 1995. "Fuzzy-Logic Based VAR Stabilizer for Power System Control", *IEE Proc. Genet. Transm. Distrib.*, Vol. 142, No. 6, pp. 618-624.
- Dash, P. K., Panda, P. C., Sharaf, A. M. and Hill, E. F. 1987. "Adaptive Controller for Static Reactive Power Compensators in Power Systems", *IEE Proc. Part-C*, Vol. 134, No. 3, pp. 256-264.
- Dash, P. K., Samantary, S.R. and Ganapathi Panda. 2007. "Fault Classification and Section Identification of an Advanced Series – Compensated Transmission Line Using Support vector machine", *IEEE Trans. Power Delivery*, Vol. 22, No. 1, pp. 67-73.
- De Oliveira, S.E.M. 1994. "Synchronizing and damping torque coefficients and power system steady-state stability as affected by static VAR compensators", *IEEE Transaction on Power Systems*, Vol. 9, No. 1, pp. 109-119.
- DeMello, F. and Concordia, C. 1969. "Concepts of Synchronous Machine Stability as Affected by Excitation Control", *IEEE Transaction. PAS*, Vol. 88, pp. 316-329.
- Eleschova, Z., Smitkova, M. and Belan, A. 2010. "Evaluation of Power System Transient Stability and Definition of the Basic Criterion", *International Journal of Energy*, Vol. 4, No. 1, pp. 9-16.
- El-Saady, G., El-Sadek, M. Z. and Abo-El-Saud, M. 1998. "Fuzzy Adaptive Model Reference Approach-Based Power

- System Static VAR Stabilizer”, *Electric Power Systems Research*, Vol. 45, No. 1, pp. 1–11.
- Girgis A. A., Sallam, A. A. and El-din, A. K. 1998. “An adaptive protection scheme foe advanced series compensated (ASC) Transmission line,” *IEEE Transaction. Power Del.*, Vol. 13, No. 1, pp. 414–420.
- Gyugi L., 1988. “Power Electronics in Electric Utilities Static Var Compensators”, *IEEE Proceedings*, Vol. 76, No. 4, pp. 483-494.
- Gyugi L., 1998. “Converter Based FACTS Controllers”, *Institution of Electrical Engineers*, pp. 1-11.
- Hammad, A. E. 1986. “Analysis of Power System Stability Enhancement by Static VAR Compensators”, *IEEE Trans. PWRS*, Vol. 1, No. 4, pp. 222–227.
- Hingorani N.G. and L. Gyugyi, 1999. “Understanding FACTS”, *IEEE press*.
- Messina, A. R. and Barocio, E. 2003. “Nonlinear Analysis of Interarea Oscillations: Effect of SVC Voltage Support”, *Electric Power Systems Research*, Vol. 64, No. 1, pp. 17–26.
- Messina, A. R., Begovich, O. and Nayebedeh, M. 1999. “Analytical Investigation of the Use of Static VAR Compensators to Aid Damping of Interarea Oscillations”, *Electric Power Systems Research*, Vol. 51, pp. 199–210.
- Padiyar, K.R. and Varma, R.K. 1991. “Damping Torque Analysis of Static VAR System Controllers”, *IEEE Transactions on Power Systems*, Vol. 6, No. 2. pp. 458-465.
- Zhou, E.Z. 1993. “Application of Static Var Compensators to Increase Power System damping”, *IEEE Transactions on Power Systems*, Vol. 8, No. 2, pp. 655-661.
